



White Paper

A guide to the assessment of thermal performance of Aluminium Products

Building Regulations **Document L**

Conservation of Fuel and Power

April 2021

Smart Architectural Aluminium

CONTENTS

INTRODUCTION.....	4
Conservation of Fuel and Power	5
Compliance Methods.....	6
Compliance Methods	7
Calculation Methods.....	8
Declaring Thermal Performance.....	9
Hot box testing and Simulations	10
UKCA and CE Marking.....	10
Window Energy Rating.....	11
Standard Assessment Procedure	11
Glass centre pane	11
U Value Calculation	12
Window Energy Rating Calculation	13
UKCA and CE Marking.....	14
Window Energy Ratings	16
Appendix	Error! Bookmark not defined.

INTRODUCTION

Building regulations document L covers the energy efficiency of building. This document summarises the areas of relevance to the fenestration industry, from the most recent publications of standards.

Highlighting the various routes to prove compliance, with an overview of calculation methods and example calculations.

The thermal performances of various Smart Systems are summarised in the appendix.

Anthony Murray (MEng)
Smart Systems

*Document Issue Date November 2013
Copyright © 2013 SMART SYSTEMS LTD
No part of this document may be reproduced without written consent of Smart Systems Ltd. This guidance document is to be read in conjunction with all relevant standards. This document is provided as is and written in good faith, but no responsibility can be accepted for errors or omissions or liability for any actions taken because of this document.*

Conservation of Fuel and Power

Recent changes in the building regulations are being driven by the commitment for the Government to continually improve thermal performance of buildings.

The building regulations part L are subdivided into L1A (new dwellings), L1B (existing dwellings), L2A (new buildings other than dwellings) and L2B (existing buildings other than dwellings). Within each of these documents are different limiting U Values setting minimum performance requirements and the calculations methods to prove compliance.

Copies of the approved documents to building regulations can be downloaded from:

www.planningportal.co.uk

Compliance Methods

New Buildings

New buildings are based on fabric limiting values and target Building CO₂ calculations based on a notional building. The limiting values have remained unchanged from 2010 at 2.0W/m²K for new Buildings and 2.2W/m²K for commercial giving building designers the flexibility to improve different building elements to achieve overall building targets.

However the overall notional building CO₂ targets have increased.

- L1A 2013 SAP New Domestic 6% CO₂ saving relative to 2010.
- L2A 2013 SBEM New Commercial 9% CO₂ saving relative to 2010.

		Fabric limiting value	Notional Building Guide*		
		U Value W/m ² K	U Value W/m ² K	g Value	Light Transmittance
L1a	New Domestic	2.0	1.4	63%	
L2a	New Commercial	2.2	1.6	40%	71%

Notional building specification prepared as a guide for all the building fabric, which if followed achieves compliance for new buildings. For the windows a notional U Value of 1.4 or 1.6, upper g value to avoid overheating and light transmission to reduce the need for artificial lighting during daylight hours.

As this is only a notional building specification different performances can be used as long as the overall building achieves the performance required. For example the SBEM notional building also proposes 0.26W/m² for walls, upgrading the performance of walls allows offsetting the performance of the windows.

Compliance Methods

Limiting Values

				Overall U Average	or	Energy Rating Band
Dwellings	New Build		Windows, roof windows, rooflights and doors	2.0		-
	Referbishment Extensions		Windows, roof windows, rooflights	1.6		C
			Doors	1.8		E
Non-Dwellings	New Build		Windows, roof windows, rooflights and doors	2.2		-
			High usage entrance doors	3.5		-
			Display windows	N/A		-
			Curtain walling	2.2		-
	Referbishment Extensions		Windows, roof windows, rooflights and doors	1.8		-
			Windows domestic in character ¹	1.6		C
			High usage entrance doors	3.5		-
			Display windows	N/A		-
			Curtain walling ²	0.8 to 1.6		-

¹ Buildings domestic in character, for example student accommodation, care homes and similar uses where the occupancy levels and internal gains are essentially domestic in character.

² Curtain walling U-Value should be no greater than:- **1.6** and $0.8 + 1.2 \frac{A_{\text{Glazed}}}{A_{\text{Total}}} + 0.6 \frac{A_{\text{Openable}}}{A_{\text{Total}}} \times \frac{A_{\text{Glazed}}}{A_{\text{Total}}}$

Calculation Methods

The fenestration **calculation methods** to prove compliance have changed with the tightening of the rules for use of Indicative and Centre Pane methods. The calculated U Values can be calculated to BS EN 14351-1 permit CE Marking to prove compliance to the UK building regulations. For domestic windows ECO Labels combine the thermal parameters to creating a window energy rating, the methodology for window energy ratings is included in the 2010 regulations.

CE Marking is included in the regulations referencing CEN window to BS EN 14351-1 providing a system method for calculating the U Value. CE Marking can be used as benchmark to compare similar products for U Value g value and air permeability.

ECO Labels simplifies the performance data to a single value, combined to provide an energy balance of losses and gains. This is based on a typical climate data to the UK and provides a comparison tool between different products.

Indicative U Value. The use of BRE's Standard Assessment Procedures are now restricted to mainly residential buildings, only applying to commercial buildings where the building is domestic in character, such as student accommodation.

Centre Pane of 1.2 provided compliance for all replacement windows in the 2006 regulations. This option is restricted to where there is a need to maintain the external appearance of the building. In these circumstances the replacement windows should meet a centre pane of $1.2\text{W/m}^2\text{K}$ alternatively single glaze windows should be supplemented with a low e secondary glazing.

Declaring Thermal Performance

	Domestic		Commercial	
	New	Replacement	New	Replacement
Hot box testing BS EN ISO 12567-1				
CE Marking BS EN ISO 14351-1				
ECO Label Window Energy rating bands				
	Replacement domestic (or domestic in character) windows only			
Glass centre pane Centre Pane < 1.2W/m²K				
	Replacement window/doors when need to maintain existing appearance only			
Indicative Method SAP2012 Table6e				
	New domestic (or domestic in character) windows only			

Hot box testing and Simulations

BS EN ISO 12567-1 BS EN ISO 10077-1 & 2

The hot box test is a physical measurement of the actual heat transfer through a particular window configuration. Based on a standard design the heat transfer is measured in a laboratory 'hot box'. Hot box testing to prove compliance can be prohibitively expensive when considering design variations.

Hot Box test provides an accurate performance, however the results cannot be used for any other sample or variant i.e. change a sash or any other part of the window make-up and a new hot box test is required to assess the thermal performance each specification variation. Finite element simulations to BS EN 10077-2, can be used in the absence of Hot Box testing; this uses numerical software packages to simulate the physical heat transfers. A simulation in accordance with BR443 can also be used to prove compliance to the UK building regulations.

Applies to:

L1a L1b L2a and L2b



UKCA and CE Marking

BS EN 14351-1

The Harmonised European standard allows general performance declarations for Windows and Doors to a common format throughout Europe. Providing commonality to the methodology and performance declarations from different countries allow free trade across Europe.

The thermal performance from the European standard can be from testing or simulation to a standard CEN Window configurations detailed BS EN14351-1. Thermal Simulation software uses finite elements to calculate the conduction and radiation of the framing sections and area weighted with the performance. U values calculated to BS EN 14351-1 can be used to prove compliance to UK building regulations L and provide compliance to building regulation 7 for energy performance.

Applies to:

L1a L1b L2a and L2b



BS EN 14351-1 applies to New build and replacement for commercial and domestic application.

Window Energy Rating

WER window energy rating bands (Domestic Windows Only)

The ratings are classified into bands A-G representing bands of WER Ratings kWh/m²/yr. Windows with a net heat loss have BFRC rating bands B-G windows with an A rating indicating a net inflow of heat, warming the property.

Window energy rating are based on the energy balance of the losses through the window offset against the solar heat gains through the window. The calculations are always on standard designs and based on typical climate data for the UK. Window energy ratings are intended as a comparator tool and the actual heat losses on the window will depend on the location design of window and climate.

Applies to:
Domestic Replacement Window Only



Only applies domestic buildings L1b refurbishment only.

WER may also apply to commercial refurbishment, if the building is domestic in character. For example, student accommodation, care homes and similar

Standard Assessment Procedure

SAP2009 Table6e

The indicative method calculates typical thermal performance of windows, doors, and roof lights. This calculation takes into account the thermal performance of the frame based on the window material thermal break size combined with thermal performance of the glass.

Applies to:
Domestic Buildings



The BRE's Standard Assessment Procedure is now only a valid calculation method for domestic buildings L1a and L1b.

SAP 2009 may also apply to commercial, if the building is domestic in character. For example, student accommodation, care homes and similar

Glass centre pane

Centre Pane < 1.2W/m²K

For replacement windows only it was possible to claim compliance with Part L1B and L2B by simply certifying or proving that the window is glazed with glazing with a 'centre of glass' U value < 1.2 irrespective of frame type.

Applies to:
Replacement and Extensions to Existing Buildings



Only applies to replacement windows and doors where there is a need to maintain the external appearance of the building and replacement windows unable to meet the requirement.


U Value Calculation

U Value of Window

The U value for a window can be calculated by summing the area weighted heat loss through the window.

- Frame
- Glass
- Glass Edge

For the purposes of UK Building regulation this is standard window defined in BR443 or in BS EN14351-1.



Specification:

Outerframe

ETC311

Vent

ETC320

Transom

ETC330

Frame

Heat loss through the frame is calculated by multiplying the areas by the U value of the individual parts of the window see table right.

Heat Loss Frame **1.031 W/K**

	U Value W/m ² K	Area m ²	Qf W/K
Outerframe	2.798	0.1026	0.2872
Mullion	2.509	0.0338	0.0848
Ventframe	2.912	0.1652	0.4809
Mullion +Vent	2.509	0.0712	0.1785
Frame Overall	2.767	0.3727	1.031

Glass

Heat loss through the glass, is calculated by the Centre Pane (U value) of the glass multiplied by the visible glazed area.

Heat Loss Glass **1.738 W/K**

	Centre Pane W/m ² K	Area m ²	Qg W/K
Glass Unit	1.2	1.449	1.738

Glass Edge

At the edge of the glass, the spacer bar has a different thermal performance to the centre of the glass. The edge spacer effect can be calculated by an edge effect coefficient ψ multiplied by the linear perimeter of the L ψ glass.

Heat Loss Glass Edge **0.292 W/K**

	Centre Pane W/m ² K	Area m ²	Qg W/K
Spacer Bar	0.039	7.508	0.292

Overall U Value

The overall U Value for the System can be calculated.

Overall U Value **1.7 W/m²K**


$$\begin{aligned}
 U_{\text{Window}} &= \frac{\text{Total Heat Losses}}{\text{Window Area}} \\
 &= \frac{1.031 + 1.738 + 0.292}{1.230 \times 1.480} \\
 U_{\text{Window}} &= \underline{\underline{1.681 \text{ W/m}^2\text{K}}}
 \end{aligned}$$

Window Energy Rating Calculation

Window Energy Rating

The Window Energy Rating WER is calculated from.

- U Value
- g Value
- Air Leakage



Heat Loss (U Value)

The heat lost through the window for a typical year in the UK.

$$68.5 \times U_{\text{Window}}$$

	W/m ² K	UK WER Factor	Heat Losses kWh/m ² Year
Heat Loss	1.681	68.5	115.148

Heat Loss (Air Leakage)

Where AL air leakage through the window in m³/h.m² at 50Pa pressure difference.

$$1.13025 \times AL$$

	AL	UK WER Factor	Heat Losses kWh/m ² Year
Air Leakage	0	1.13025	0

Solar Gain (g Value)

The solar gain of the window is calculated from the g value of the glass multiplied by the visible area of glazing.

$$196.7 \times (1-f) \times g_{\text{glass}}$$

$$196.7 \times (0.795) \times 0.74$$

	g _{Window}	UK WER Factor	Solar Gains kWh/m ² Year
Solar Gains	0.5883	196.7	115.719

WER Value

The annual energy balance for the window can be calculated from the Solar Gains offset against the Heat Losses:
 115.719 – 115.148

Window Energy Rating
+ 0.4kWh/m²Year.

The window energy band is assigned based on the typical heat balance.


Window Energy Band
BAND A

WER Band	WER (kWh/m ² Year)
A	0
B	0 to -10
C	-10 to -20
D	-20 to -30
E	-30 to -50
F	-50 to -70
G	-70 or more

UKCA and CE Marking

Applies to L1a L1b L2a L2b


UKCA Marking cover varied construction products, the harmonised standard for windows and doors is implemented BS EN 14351-1, this cover many performance aspects including weather, impact and acoustics performance including calculations for the thermal characteristics.

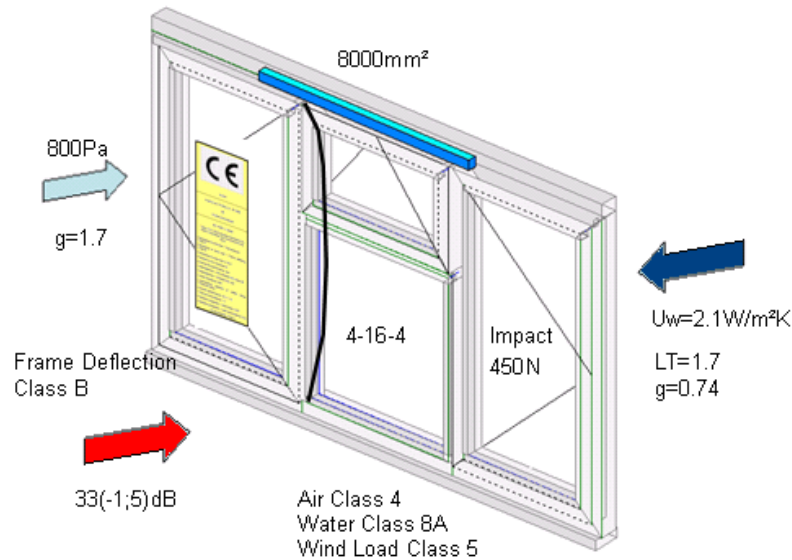

BS EN 14351-1 Windows and Door Product Standard

BS EN 14351-1 allows for clear comparisons between the performances from different suppliers allowing informed choices to be made on all characteristics and to select the highest performing products.

U Value calculation to BS EN 14351-1 is based on CEN windows and can be used to comply with the U Value requirements for commercial and domestic applications. WER are suited to refurbishment domestic CE Marking U Values are suited to new buildings and commercial buildings. This allows for the overall energy in new buildings to be calculated through SBEM or SAP calculations including allowances for overheating.

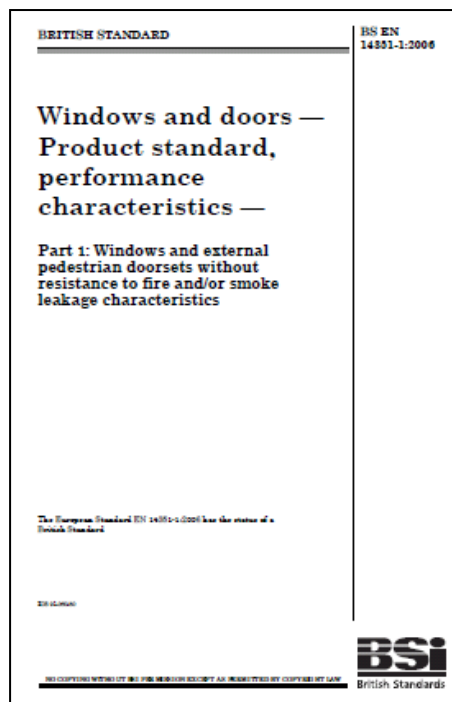

Conformity Marking UKCA Mark

smart architectural aluminium

WINDOWS DOORS SCREENS

UKCA Mark Weather Thermal/Acoustic Structure Security Other Declaration

System: Alitherm 700


Glass: Centre Pane Solar Factor Light Transm Glass Sound Rw (C,Ct)

Space Bar: Sweepseal V 0.039 U Window 1.6 Sound Overall Rw(C,Ct)

*Thermal performance levels are MANDATORY in the UK, refer to building regulations.

	Characteristic Value Dimension	Classification Value	Class declared Value
3	4.3 Resistance to snow loads	npd	npd
11	4.12 Thermal Transmittance U Value (Uw) (W/m ² K)	1.6	1.6
12	4.13 Solar Factor Radiation Properties (g)	npd	npd
13	4.13 Light transmittance	npd	npd


<< Previous Next >>

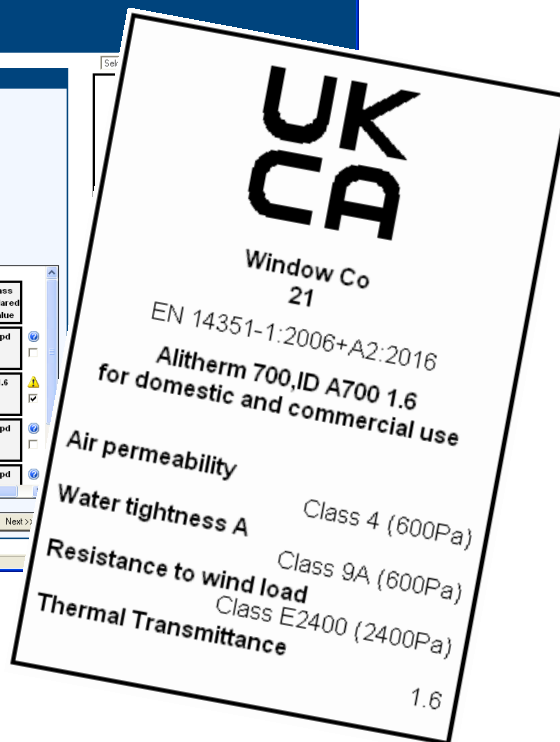

Window Energy Ratings


Applies to L1b

Window Energy Ratings calculate the “energy balance” of a typical window by combining the heat losses and offset against heat gains due to the sun.

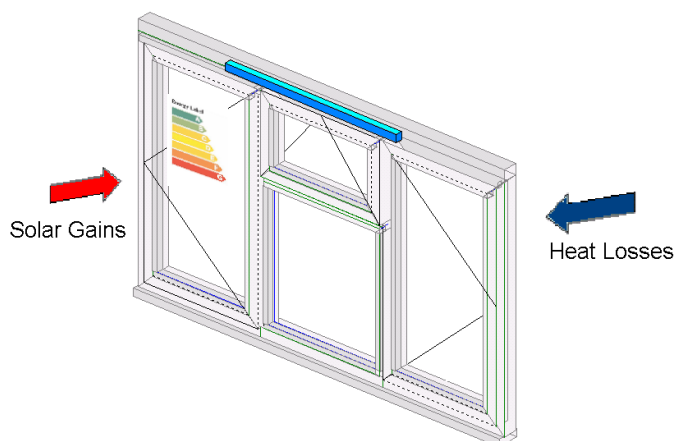

The resulting energy balance, the difference between the gains and losses is the Window Energy Rating expressed in kWh/m² per Year. Window with high solar gains can completely offset the heat losses from the window resulting in a windows which is a net heat contributor to the property.

The values used to calculate the energy balance are based on typical values of sunshine and climate for the UK for a typical window. This actual window configuration including the glass specification can be modelled by a Smarts Dealer to provide a detailed energy report and WER label.

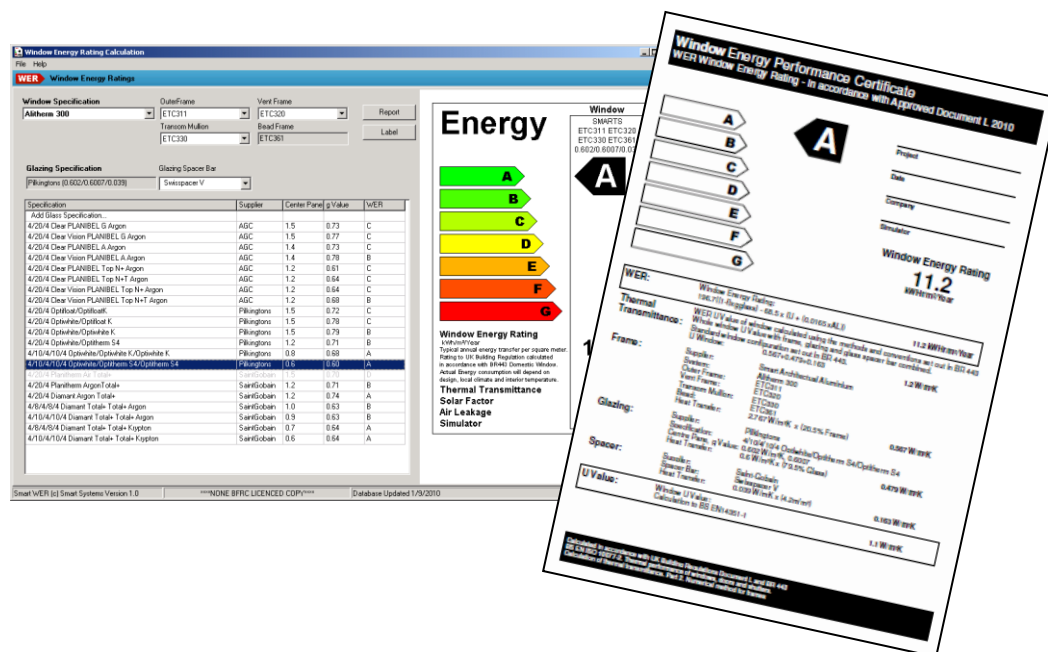

Understanding the ratings

The ratings are from A to G with A being most efficient and G rated windows losing the most amount of heat. Band A is a window where the solar gains are larger than the heat losses, band B to G the window will lose heat. The energy balance is calculated for a typical year in the UK and calculates the energy in kWh per square metre of window.

The effective cost for the typical window would depend on the cost of heating and number of windows. The following table shows typical annual savings based on the cost of gas heating for different sized properties.

Typical contribution of windows to annual heating bill						
WER (kWh/m ² Year)	Rating	Window 1m x 1m	Flat 6.9m ²	Terraced 12.7m ²	Semi 16.9m ²	Detached 23.7m ²
0	A	£0	£0	£0	£0	£0
0 to -10	B	£0.40	£3	£5	£7	£9
-10 to -20	C	£0.80	£6	£10	£13	£19
-20 to -30	D	£1.20	£9	£15	£20	£28
-30 to -50	E	£2.00	£14	£25	£34	£47
-50 to -70	F	£2.80	£20	£36	£47	£66
-70 or more	G	£2.80+	£20+	£36+	£47+	£66+
Double Glazed PVCu Installed Windows in 2002		£4.23	£29	£54	£72	£100

¹Source GGF Energy Saving Calculator Based on Gas Heating
 Heating costs Gas 0.04£/KWh, Electric 0.083£/KWh, Oil 0.061£/KWh Oil, Solid Fuel 0.027£/KWh. Double Glazed PVCu in 2002 with DGU with 20mm spacer bar commercial domestic

Example

A detached house with PVCu window 8 years old replaced with C Rated Windows Aluminium the heat losses would drop from £100 per year to £19 saving £81 per year.

A1	Alitherm 300
A2	Alitherm 400
A3	Alitherm 400 Door
A4	Alitherm 500
A5	Alitherm 600
A6	Alitherm 700
A7	Alitherm 700 Reversible
A8	Alitherm 800
A9	Alitherm Heritage
A10	Alitherm Heritage (Door)
A11	Alitherm/Alitherm Plus Door
A12	EcoFutural Casement EFi+
A13	EcoFutural EFi+
A14	EcoFutural Pivot EFi+
A15	EcoFutural Door
A16	Shoptline
A17	Slide 2000
A18	Smart Wall
A19	UltraGlide
A20	Visofold 1000
A21	Visofold 2000
A22	Visofold 3000
A23	Visofold 4000
A24	Visofold 5000
A25	Visofold 6000
A26	Visoglide
A27	Visoglide Plus
A28	VS 600
A29	Designer Door
A30	Orangery
A31	Rooflight

Thermal Performance

Alitherm 300

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
0.3									
0.4	0.4	0.4	0.4	0.4	0.5	0.5	0.5	0.5	0.5
0.5	0.5	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6
0.6	0.6	0.7	0.7	0.7	0.7	0.8	0.8	0.8	0.8
0.8	0.8	0.8	0.8	0.8	0.9	0.9	0.9	0.9	0.9
0.9	0.9	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
1.0	1.0	1.1	1.1	1.1	1.2	1.2	1.2	1.2	1.2
1.2	1.2	1.2	1.2	1.3	1.3	1.3	1.3	1.3	1.3
1.3	1.3	1.4	1.4	1.4	1.4	1.4	1.4	1.4	1.4
1.4	1.4	1.5	1.5	1.5	1.6	1.6	1.6	1.6	1.6
1.6	1.6	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7
1.7	1.7	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.8
1.8	1.8	1.9	1.9	1.9	2.0	2.0	2.0	2.0	2.0
2.0	2.0	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1
2.1	2.1	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2
2.3	2.3	2.3	2.3	2.3	2.4	2.4	2.4	2.4	2.4

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	①	●	●
●	①	●	●
●	①	●	○
●	①	●	○
○	①	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 10077-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

•①L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance

Alitherm 400

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
0.4	0.4	0.4	0.4	0.4	0.5	0.5	0.5	0.5	0.5
0.4	0.5	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6
0.5	0.6	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
0.6	0.7	0.8	0.8	0.8	0.8	0.9	0.9	0.9	0.9
0.7	0.9	0.9	0.9	0.9	1.0	1.0	1.0	1.0	1.0
0.9	1.0	1.1	1.1	1.1	1.1	1.1	1.1	1.1	1.1
1.0	1.1	1.2	1.2	1.2	1.2	1.2	1.2	1.2	1.2
1.1	1.2	1.3	1.3	1.3	1.3	1.4	1.4	1.4	1.4
1.2	1.4	1.4	1.4	1.4	1.5	1.5	1.5	1.5	1.5
1.4	1.5	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6
1.5	1.6	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7
1.6	1.7	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.9
1.7	1.9	1.9	1.9	1.9	2.0	2.0	2.0	2.0	2.0
1.8	2.0	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1
2.0	2.1	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2
2.1	2.2	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3
2.2	2.4	2.4	2.4	2.4	2.5	2.5	2.5	2.5	2.5

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	①	●	●
●	①	●	●
●	①	●	○
○	①	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 1007-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

•①L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance

Alitherm 400 Door

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4
0.3	0.4	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
0.5	0.6	0.6	0.6	0.7	0.7	0.7	0.7	0.7	0.7
0.6	0.7	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
0.7	0.9	0.9	0.9	0.9	1.0	1.0	1.0	1.0	1.0
0.9	1.0	1.1	1.1	1.1	1.1	1.1	1.1	1.1	1.1
1.0	1.2	1.2	1.2	1.2	1.3	1.3	1.3	1.3	1.3
1.2	1.3	1.4	1.4	1.4	1.4	1.4	1.4	1.4	1.4
1.3	1.5	1.5	1.5	1.5	1.5	1.6	1.6	1.6	1.6
1.5	1.6	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7
1.6	1.7	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.8
1.8	1.9	1.9	1.9	2.0	2.0	2.0	2.0	2.0	2.0
1.9	2.0	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1
2.0	2.2	2.2	2.2	2.2	2.3	2.3	2.3	2.3	2.3
2.2	2.3	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4
2.3	2.5	2.5	2.5	2.5	2.6	2.6	2.6	2.6	2.6
2.5	2.6	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	○	●	○
●	○	●	○
○	○	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 10077-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

•L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance

Alitherm 500

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
0.4	0.4	0.4	0.4	0.4	0.5	0.5	0.5	0.5	0.5
0.4	0.5	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6
0.5	0.6	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
0.6	0.7	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
0.7	0.9	0.9	0.9	0.9	1.0	1.0	1.0	1.0	1.0
0.8	1.0	1.0	1.0	1.0	1.1	1.1	1.1	1.1	1.1
1.0	1.1	1.2	1.2	1.2	1.2	1.2	1.2	1.2	1.2
1.1	1.2	1.3	1.3	1.3	1.3	1.3	1.3	1.3	1.3
1.2	1.3	1.4	1.4	1.4	1.4	1.5	1.5	1.5	1.5
1.3	1.5	1.5	1.5	1.5	1.6	1.6	1.6	1.6	1.6
1.5	1.6	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7
1.6	1.7	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.8
1.7	1.8	1.9	1.9	1.9	1.9	1.9	1.9	1.9	1.9
1.8	2.0	2.0	2.0	2.0	2.1	2.1	2.1	2.1	2.1
1.9	2.1	2.1	2.1	2.1	2.2	2.2	2.2	2.2	2.2
2.1	2.2	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3
2.2	2.3	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	①	●	●
●	①	●	●
●	①	●	○
●	①	●	○
○	①	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 10077-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

•①L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance

Alitherm 600

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
1.0									
1.1					0.3	0.3	0.3	0.3	0.3
1.2	0.4	0.4	0.4	0.4	0.5	0.5	0.5	0.5	0.5
1.3	0.3	0.5	0.6	0.6	0.6	0.6	0.6	0.6	0.6
1.4	0.5	0.6	0.7	0.7	0.7	0.7	0.7	0.7	0.7
1.5	0.6	0.8	0.8	0.8	0.9	0.9	0.9	0.9	0.9
1.6	0.8	0.9	1.0	1.0	1.0	1.0	1.0	1.0	1.0
1.7	0.9	1.0	1.1	1.1	1.1	1.2	1.2	1.2	1.2
1.8	1.0	1.2	1.2	1.2	1.2	1.3	1.3	1.3	1.3
1.9	1.2	1.3	1.4	1.4	1.4	1.4	1.4	1.4	1.4
2.0	1.3	1.4	1.5	1.5	1.5	1.6	1.6	1.6	1.6
2.1	1.4	1.6	1.6	1.6	1.7	1.7	1.7	1.7	1.7
2.2	1.6	1.7	1.8	1.8	1.8	1.8	1.8	1.8	1.8
2.3	1.7	1.8	1.9	1.9	1.9	2.0	2.0	2.0	2.0
2.4	1.8	2.0	2.1	2.1	2.1	2.1	2.1	2.1	2.1
2.5	2.0	2.1	2.2	2.2	2.2	2.2	2.2	2.2	2.2
2.6	2.1	2.3	2.3	2.3	2.3	2.4	2.4	2.4	2.4

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	①	●	●
●	①	●	●
●	①	●	○
●	①	●	○
○	①	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 10077-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

•①L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance

Alitherm 700

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
1.0									
1.1					0.3	0.3	0.3	0.3	0.3
1.2	0.4	0.4	0.4	0.4	0.5	0.5	0.5	0.5	0.5
1.3	0.3	0.5	0.6	0.6	0.6	0.6	0.6	0.6	0.6
1.4	0.5	0.6	0.7	0.7	0.7	0.7	0.7	0.7	0.7
1.5	0.6	0.8	0.8	0.8	0.9	0.9	0.9	0.9	0.9
1.6	0.8	0.9	1.0	1.0	1.0	1.0	1.0	1.0	1.0
1.7	0.9	1.0	1.1	1.1	1.1	1.2	1.2	1.2	1.2
1.8	1.0	1.2	1.2	1.2	1.3	1.3	1.3	1.3	1.3
1.9	1.2	1.3	1.4	1.4	1.4	1.4	1.4	1.4	1.4
2.0	1.3	1.4	1.5	1.5	1.6	1.6	1.6	1.6	1.6
2.1	1.4	1.6	1.6	1.7	1.7	1.7	1.7	1.7	1.7
2.2	1.6	1.7	1.8	1.8	1.8	1.8	1.8	1.8	1.8
2.3	1.7	1.8	1.9	1.9	2.0	2.0	2.0	2.0	2.0
2.4	1.8	2.0	2.1	2.1	2.1	2.1	2.1	2.1	2.1
2.5	2.0	2.1	2.2	2.2	2.2	2.2	2.2	2.2	2.2
2.6	2.1	2.3	2.3	2.3	2.4	2.4	2.4	2.4	2.4

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	①	●	●
●	①	●	●
●	①	●	○
●	①	●	○
○	①	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 1007-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

•①L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance

Alitherm 700 Reversible

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
0.3	0.3	0.3	0.4	0.4	0.4	0.4	0.4	0.4	0.4
0.4	0.4	0.4	0.5	0.5	0.5	0.5	0.5	0.5	0.5
0.4	0.5	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6
0.5	0.6	0.7	0.7	0.7	0.8	0.8	0.8	0.8	0.8
0.6	0.8	0.8	0.8	0.9	0.9	0.9	0.9	0.9	0.9
0.8	0.9	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
0.9	1.0	1.1	1.1	1.1	1.2	1.2	1.2	1.2	1.2
1.0	1.2	1.2	1.2	1.3	1.3	1.3	1.3	1.3	1.3
1.2	1.3	1.4	1.4	1.4	1.4	1.4	1.4	1.4	1.4
1.3	1.4	1.5	1.5	1.5	1.6	1.6	1.6	1.6	1.6
1.4	1.6	1.6	1.6	1.7	1.7	1.7	1.7	1.7	1.7
1.6	1.7	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.8
1.7	1.8	1.9	1.9	1.9	2.0	2.0	2.0	2.0	2.0
1.8	2.0	2.0	2.0	2.1	2.1	2.1	2.1	2.1	2.1
2.0	2.1	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2
2.1	2.2	2.3	2.3	2.3	2.4	2.4	2.4	2.4	2.4
2.2	2.4	2.4	2.4	2.5	2.5	2.5	2.5	2.5	2.5

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	①	●	●
●	①	●	●
●	①	●	○
●	①	●	○
○	①	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 10077-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

•①L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance

Alitherm 800

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
1.0					0.3	0.3	0.3	0.3	0.3
1.1	0.3	0.4	0.4	0.4	0.5	0.5	0.5	0.5	0.5
1.2	0.3	0.5	0.5	0.5	0.6	0.6	0.6	0.6	0.6
1.3	0.5	0.6	0.7	0.7	0.7	0.7	0.7	0.7	0.7
1.4	0.6	0.7	0.8	0.8	0.8	0.9	0.9	0.9	0.9
1.5	0.7	0.9	1.0	1.0	1.0	1.0	1.0	1.0	1.0
1.6	0.9	1.0	1.1	1.1	1.1	1.1	1.1	1.1	1.1
1.7	1.0	1.2	1.2	1.2	1.2	1.3	1.3	1.3	1.3
1.8	1.1	1.3	1.4	1.4	1.4	1.4	1.4	1.4	1.4
1.9	1.3	1.4	1.5	1.5	1.5	1.5	1.5	1.5	1.5
2.0	1.4	1.6	1.6	1.6	1.6	1.7	1.7	1.7	1.7
2.1	1.6	1.7	1.8	1.8	1.8	1.8	1.8	1.8	1.8
2.2	1.7	1.8	1.9	1.9	1.9	2.0	2.0	2.0	2.0
2.3	1.8	2.0	2.0	2.0	2.0	2.1	2.1	2.1	2.1
2.4	2.0	2.1	2.2	2.2	2.2	2.2	2.2	2.2	2.2
2.5	2.1	2.2	2.3	2.3	2.3	2.4	2.4	2.4	2.4
2.6	2.2	2.4	2.4	2.4	2.5	2.5	2.5	2.5	2.5

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	①	●	●
●	①	●	○
●	①	●	○
○	①	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 10077-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

•①L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance

Alitherm Heritage

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
1.0		0.3	0.3	0.4	0.4	0.4	0.4	0.4	0.4
1.1	0.4	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
1.2	0.4	0.5	0.6	0.6	0.6	0.6	0.6	0.6	0.6
1.3	0.5	0.6	0.7	0.7	0.7	0.7	0.7	0.7	0.8
1.4	0.6	0.8	0.8	0.8	0.8	0.9	0.9	0.9	0.9
1.5	0.7	0.9	0.9	0.9	0.9	1.0	1.0	1.0	1.0
1.6	0.9	1.0	1.1	1.1	1.1	1.1	1.1	1.1	1.1
1.7	1.0	1.1	1.2	1.2	1.2	1.2	1.2	1.2	1.2
1.8	1.1	1.2	1.3	1.3	1.3	1.3	1.3	1.3	1.4
1.9	1.2	1.4	1.4	1.4	1.4	1.5	1.5	1.5	1.5
2.0	1.3	1.5	1.5	1.5	1.5	1.6	1.6	1.6	1.6
2.1	1.5	1.6	1.7	1.7	1.7	1.7	1.7	1.7	1.7
2.2	1.6	1.7	1.8	1.8	1.8	1.8	1.8	1.8	1.8
2.3	1.7	1.8	1.9	1.9	1.9	1.9	1.9	1.9	2.0
2.4	1.8	2.0	2.0	2.0	2.0	2.1	2.1	2.1	2.1
2.5	1.9	2.1	2.1	2.1	2.1	2.2	2.2	2.2	2.2
2.6	2.1	2.2	2.3	2.3	2.3	2.3	2.3	2.3	2.3

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	①	●	●
●	①	●	●
●	①	●	○
●	①	●	○
○	①	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 10077-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

•①L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance Alitherm Heritage (Door)

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
0.4	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
0.4	0.5	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6
0.5	0.6	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
0.6	0.7	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
0.7	0.9	0.9	0.9	0.9	0.9	1.0	1.0	1.0	1.0
0.9	1.0	1.0	1.0	1.0	1.1	1.1	1.1	1.1	1.1
1.0	1.1	1.2	1.2	1.2	1.2	1.2	1.2	1.2	1.2
1.1	1.2	1.3	1.3	1.3	1.3	1.3	1.3	1.3	1.3
1.2	1.3	1.4	1.4	1.4	1.4	1.4	1.4	1.4	1.4
1.3	1.4	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5
1.4	1.6	1.6	1.6	1.6	1.7	1.7	1.7	1.7	1.7
1.6	1.7	1.7	1.7	1.7	1.8	1.8	1.8	1.8	1.8
1.7	1.8	1.9	1.9	1.9	1.9	1.9	1.9	1.9	1.9
1.8	1.9	2.0	2.0	2.0	2.0	2.0	2.0	2.0	2.0
1.9	2.0	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1
2.0	2.1	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2
2.2	2.3	2.3	2.3	2.3	2.4	2.4	2.4	2.4	2.4

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	○	●	○
●	○	●	○
○	○	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2


¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 10077-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

•L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
					0.3	0.3	0.3	0.4	0.4
		0.4	0.5	0.5	0.5	0.5	0.5	0.5	0.5
0.4	0.6	0.6	0.6	0.6	0.7	0.7	0.7	0.7	0.7
0.6	0.7	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
0.7	0.8	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9
0.8	1.0	1.0	1.0	1.0	1.1	1.1	1.1	1.1	1.1
1.0	1.1	1.2	1.2	1.2	1.2	1.2	1.2	1.2	1.2
1.1	1.3	1.3	1.3	1.3	1.3	1.4	1.4	1.4	1.4
1.3	1.4	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5
1.4	1.5	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6
1.5	1.7	1.7	1.7	1.7	1.8	1.8	1.8	1.8	1.8
1.7	1.8	1.9	1.9	1.9	1.9	1.9	1.9	1.9	1.9
1.8	2.0	2.0	2.0	2.0	2.0	2.1	2.1	2.1	2.1
2.0	2.1	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2

ADL			
Domestic		Commercial	
L1A New Domestic		L2A New Commercial	
L1B Referb Domestic		L2B Referb Commercial	
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	○	●	○
●	○	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○
○	○	○	○

- **①L1B** dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance

EcoFutural Casement EFi+

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
0.4	0.3	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4
0.6	0.4	0.5	0.5	0.5	0.5	0.6	0.6	0.6	0.6
0.7	0.6	0.6	0.6	0.6	0.7	0.7	0.7	0.7	0.7
0.8	0.7	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
0.9	0.8	0.9	0.9	0.9	1.0	1.0	1.0	1.0	1.0
1.0	1.0	1.0	1.0	1.0	1.1	1.1	1.1	1.1	1.1
1.1	1.1	1.2	1.2	1.2	1.2	1.2	1.2	1.2	1.2
1.2	1.2	1.3	1.3	1.3	1.4	1.4	1.4	1.4	1.4
1.3	1.3	1.4	1.4	1.4	1.5	1.5	1.5	1.5	1.5
1.4	1.4	1.5	1.5	1.5	1.6	1.6	1.6	1.6	1.6
1.5	1.5	1.6	1.6	1.6	1.7	1.7	1.7	1.7	1.7
1.6	1.6	1.7	1.7	1.7	1.8	1.8	1.8	1.8	1.8
1.7	1.7	1.8	1.8	1.8	1.9	1.9	1.9	1.9	1.9
1.8	1.8	1.9	1.9	1.9	2.0	2.0	2.0	2.0	2.0
1.9	1.9	2.0	2.0	2.0	2.1	2.1	2.1	2.1	2.1
2.0	2.0	2.1	2.1	2.1	2.2	2.2	2.2	2.2	2.2
2.1	2.1	2.2	2.2	2.2	2.3	2.3	2.3	2.3	2.3
2.2	2.2	2.3	2.3	2.3	2.4	2.4	2.4	2.4	2.4

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	①	●	●
●	①	●	●
●	①	●	○
●	①	●	○
○	①	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 10077-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

•①L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance

EcoFutural EFi+

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
1.0	0.4	0.4	0.4	0.4	0.5	0.5	0.5	0.5	0.5
1.1	0.4	0.5	0.6	0.6	0.6	0.6	0.6	0.6	0.6
1.2	0.5	0.7	0.7	0.7	0.8	0.8	0.8	0.8	0.8
1.3	0.7	0.8	0.9	0.9	0.9	0.9	0.9	0.9	0.9
1.4	0.8	0.9	1.0	1.0	1.1	1.1	1.1	1.1	1.1
1.5	0.9	1.1	1.2	1.2	1.2	1.2	1.2	1.2	1.2
1.6	1.1	1.2	1.3	1.3	1.3	1.4	1.4	1.4	1.4
1.7	1.2	1.4	1.4	1.4	1.5	1.5	1.5	1.5	1.5
1.8	1.4	1.5	1.6	1.6	1.6	1.6	1.6	1.6	1.6
1.9	1.5	1.7	1.7	1.7	1.8	1.8	1.8	1.8	1.8
2.0	1.7	1.8	1.9	1.9	1.9	1.9	1.9	1.9	1.9
2.1	1.8	1.9	2.0	2.0	2.1	2.1	2.1	2.1	2.1
2.2	1.9	2.1	2.2	2.2	2.2	2.2	2.2	2.2	2.2
2.3	2.1	2.2	2.3	2.3	2.3	2.4	2.4	2.4	2.4
2.4	2.2	2.4	2.4	2.4	2.5	2.5	2.5	2.5	2.5
2.5	2.4	2.5	2.6	2.6	2.6	2.6	2.6	2.6	2.6
2.6	2.5	2.7	2.7	2.7	2.8	2.8	2.8	2.8	2.8

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	①	●	●
●	①	●	●
●	①	●	○
●	①	●	○
○	①	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 10077-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

•①L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance

EcoFutural Door

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
1.0									
1.1	0.3	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4
1.2	0.3	0.5	0.5	0.5	0.6	0.6	0.6	0.6	0.6
1.3	0.5	0.6	0.7	0.7	0.7	0.7	0.7	0.7	0.7
1.4	0.6	0.8	0.8	0.8	0.9	0.9	0.9	0.9	0.9
1.5	0.8	0.9	1.0	1.0	1.0	1.0	1.0	1.0	1.0
1.6	0.9	1.1	1.1	1.1	1.2	1.2	1.2	1.2	1.2
1.7	1.1	1.2	1.3	1.3	1.3	1.3	1.3	1.3	1.3
1.8	1.2	1.4	1.4	1.4	1.5	1.5	1.5	1.5	1.5
1.9	1.4	1.5	1.6	1.6	1.6	1.6	1.6	1.6	1.6
2.0	1.5	1.7	1.7	1.7	1.8	1.8	1.8	1.8	1.8
2.1	1.7	1.8	1.9	1.9	1.9	1.9	1.9	1.9	1.9
2.2	1.8	2.0	2.0	2.0	2.1	2.1	2.1	2.1	2.1
2.3	2.0	2.1	2.2	2.2	2.2	2.2	2.2	2.2	2.2
2.4	2.1	2.3	2.3	2.3	2.4	2.4	2.4	2.4	2.4
2.5	2.3	2.4	2.5	2.5	2.5	2.5	2.5	2.5	2.5
2.6	2.4	2.6	2.6	2.6	2.6	2.7	2.7	2.7	2.7

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	○	●	○
●	○	●	○
○	○	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 10077-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

• L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
☐	☐	☒	☒
☐	☐	☒	☒
☐	☐	☒	☒
☐	☐	☒	☒
☐	☐	☒	☒
☐	☐	☒	☒
☐	☐	☒	☒
☐	☐	☒	☒
☐	☐	☒	☒
☐	☐	☒	☒
☐	☐	☐	☐
☐	☐	☐	☐
☐	☐	☐	☐
☐	☐	☐	☐
☐	☐	☐	☐

- ① L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance

Slide 2000

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
1.0									
1.1									
1.2	0.3	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4
1.3	0.3	0.4	0.5	0.5	0.5	0.5	0.5	0.5	0.5
1.4	0.5	0.6	0.6	0.6	0.6	0.7	0.7	0.7	0.7
1.5	0.6	0.7	0.8	0.8	0.8	0.8	0.8	0.8	0.8
1.6	0.7	0.9	0.9	0.9	0.9	1.0	1.0	1.0	1.0
1.7	0.9	1.0	1.0	1.0	1.1	1.1	1.1	1.1	1.1
1.8	1.0	1.1	1.2	1.2	1.2	1.2	1.2	1.2	1.2
1.9	1.1	1.3	1.3	1.3	1.4	1.4	1.4	1.4	1.4
2.0	1.3	1.4	1.5	1.5	1.5	1.5	1.5	1.5	1.5
2.1	1.4	1.5	1.6	1.6	1.6	1.6	1.6	1.6	1.6
2.2	1.5	1.7	1.7	1.7	1.7	1.8	1.8	1.8	1.8
2.3	1.7	1.8	1.9	1.9	1.9	1.9	1.9	1.9	1.9
2.4	1.8	1.9	2.0	2.0	2.0	2.0	2.0	2.0	2.0
2.5	1.9	2.1	2.1	2.1	2.1	2.2	2.2	2.2	2.2
2.6	2.1	2.2	2.3	2.3	2.3	2.3	2.3	2.3	2.3

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	○	●	○
●	○	●	○
○	○	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 10077-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

• L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
					0.3	0.3	0.3	0.3	0.3
	0.3	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4
0.3	0.5	0.5	0.5	0.5	0.6	0.6	0.6	0.6	0.6
0.5	0.6	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
0.7	0.8	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9
0.8	0.9	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
1.0	1.1	1.2	1.2	1.2	1.2	1.2	1.2	1.2	1.2
1.1	1.2	1.3	1.3	1.3	1.3	1.4	1.4	1.4	1.4
1.3	1.4	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5
1.4	1.6	1.6	1.6	1.6	1.7	1.7	1.7	1.7	1.7
1.6	1.7	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.8
1.7	1.9	1.9	1.9	1.9	2.0	2.0	2.0	2.0	2.0
1.9	2.0	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1

[illegible]

Calculation in accordance with BR443. Thermal transmittance of system from numerical method of simulations. BS EN ISO 10077-2

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

- ①L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K	Glazing Specification										ADL				
	Typical Spacer Bar Performances ²										Domestic		Commercial		
	W/m										L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial	
	Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035					
	Centre Pane ¹														
	W/m²K														
	1.0														
	1.1														
	1.2														
1.3						0.3	0.3	0.3	0.3	0.3					
1.4		0.4	0.4	0.4	0.5	0.5	0.5	0.5	0.5	0.5					
1.5	0.4	0.5	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.7					
1.6	0.6	0.7	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8					
1.7	0.7	0.9	0.9	0.9	0.9	1.0	1.0	1.0	1.0	1.0					
1.8	0.9	1.0	1.1	1.1	1.1	1.1	1.1	1.1	1.1	1.1					
1.9	1.0	1.2	1.2	1.2	1.2	1.3	1.3	1.3	1.3	1.3					
2.0	1.2	1.3	1.4	1.4	1.4	1.4	1.4	1.4	1.4	1.4					
2.1	1.3	1.5	1.5	1.5	1.5	1.6	1.6	1.6	1.6	1.6					
2.2	1.5	1.6	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7					
2.3	1.6	1.8	1.8	1.8	1.9	1.9	1.9	1.9	1.9	1.9					
2.4	1.8	1.9	2.0	2.0	2.0	2.0	2.0	2.0	2.0	2.0					
2.5	2.0	2.1	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2					
2.6	2.1	2.2	2.3	2.3	2.3	2.3	2.4	2.4	2.4	2.4					

								</		

Calculation in accordance with BR443. Thermal transmittance of system from numerical method of simulations. BS EN ISO 10077-2

- ① L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance

Visofold 1000

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
0.3					0.3	0.3	0.3	0.3	0.3
0.4	0.4	0.4	0.4	0.4	0.5	0.5	0.5	0.5	0.5
0.5	0.5	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6
0.6	0.6	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
0.7	0.7	0.8	0.8	0.8	0.8	0.9	0.9	0.9	0.9
0.8	0.8	0.9	0.9	0.9	0.9	1.0	1.0	1.0	1.0
0.9	0.9	1.0	1.0	1.0	1.0	1.1	1.1	1.1	1.1
1.0	1.0	1.1	1.1	1.1	1.1	1.2	1.2	1.2	1.2
1.1	1.1	1.2	1.2	1.2	1.2	1.3	1.3	1.3	1.3
1.2	1.2	1.3	1.3	1.3	1.3	1.4	1.4	1.4	1.4
1.3	1.3	1.4	1.4	1.4	1.4	1.5	1.5	1.5	1.5
1.4	1.4	1.5	1.5	1.5	1.5	1.6	1.6	1.6	1.6
1.5	1.5	1.6	1.6	1.6	1.6	1.7	1.7	1.7	1.7
1.6	1.6	1.7	1.7	1.7	1.7	1.8	1.8	1.8	1.8
1.7	1.7	1.8	1.8	1.8	1.8	1.9	1.9	1.9	1.9
1.8	1.8	1.9	1.9	1.9	1.9	2.0	2.0	2.0	2.0
1.9	1.9	2.0	2.0	2.0	2.0	2.1	2.1	2.1	2.1
2.0	2.0	2.1	2.1	2.1	2.1	2.2	2.2	2.2	2.2
2.1	2.1	2.2	2.2	2.2	2.2	2.3	2.3	2.3	2.3
2.2	2.2	2.3	2.3	2.3	2.3	2.4	2.4	2.4	2.4

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	○	●	○
●	○	●	○
○	○	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 10077-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

• L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance

Visofold 2000

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
0.4	0.5	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6
0.5	0.7	0.7	0.7	0.7	0.8	0.8	0.8	0.8	0.8
0.7	0.8	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9
0.8	0.9	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
0.9	1.1	1.1	1.1	1.1	1.2	1.2	1.2	1.2	1.2
1.1	1.2	1.3	1.3	1.3	1.3	1.3	1.3	1.3	1.3
1.2	1.3	1.4	1.4	1.4	1.4	1.4	1.4	1.4	1.4
1.4	1.5	1.5	1.5	1.5	1.6	1.6	1.6	1.6	1.6
1.5	1.6	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7
1.6	1.7	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.9
1.8	1.9	1.9	1.9	1.9	2.0	2.0	2.0	2.0	2.0
1.9	2.0	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1
2.0	2.2	2.2	2.2	2.2	2.2	2.3	2.3	2.3	2.3
2.2	2.3	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	○	●	○
●	○	●	○
○	○	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 1007-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

•L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance

Visofold 3000

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
0.4	0.5	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6
0.5	0.7	0.7	0.7	0.7	0.8	0.8	0.8	0.8	0.8
0.7	0.8	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9
0.8	0.9	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
0.9	1.1	1.1	1.1	1.1	1.2	1.2	1.2	1.2	1.2
1.1	1.2	1.3	1.3	1.3	1.3	1.3	1.3	1.3	1.3
1.2	1.3	1.4	1.4	1.4	1.4	1.4	1.4	1.4	1.4
1.4	1.5	1.5	1.5	1.5	1.6	1.6	1.6	1.6	1.6
1.5	1.6	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7
1.6	1.7	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.9
1.8	1.9	1.9	1.9	1.9	2.0	2.0	2.0	2.0	2.0
1.9	2.0	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1
2.0	2.2	2.2	2.2	2.2	2.2	2.3	2.3	2.3	2.3
2.2	2.3	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	○	●	○
●	○	●	○
○	○	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 10077-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

• L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance

Visofold 4000

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
1.0									
1.1									
1.2	0.3	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4
1.3	0.3	0.4	0.5	0.5	0.5	0.5	0.5	0.5	0.5
1.4	0.5	0.6	0.6	0.6	0.6	0.7	0.7	0.7	0.7
1.5	0.6	0.7	0.8	0.8	0.8	0.8	0.8	0.8	0.8
1.6	0.7	0.8	0.9	0.9	0.9	0.9	0.9	0.9	0.9
1.7	0.9	1.0	1.0	1.0	1.0	1.1	1.1	1.1	1.1
1.8	1.0	1.1	1.2	1.2	1.2	1.2	1.2	1.2	1.2
1.9	1.1	1.3	1.3	1.3	1.3	1.4	1.4	1.4	1.4
2.0	1.3	1.4	1.4	1.4	1.5	1.5	1.5	1.5	1.5
2.1	1.4	1.5	1.6	1.6	1.6	1.6	1.6	1.6	1.6
2.2	1.5	1.7	1.7	1.7	1.7	1.8	1.8	1.8	1.8
2.3	1.7	1.8	1.9	1.9	1.9	1.9	1.9	1.9	1.9
2.4	1.8	1.9	2.0	2.0	2.0	2.0	2.0	2.0	2.0
2.5	1.9	2.1	2.1	2.1	2.1	2.2	2.2	2.2	2.2
2.6	2.1	2.2	2.3	2.3	2.3	2.3	2.3	2.3	2.3

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	○	●	○
●	○	●	○
○	○	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 10077-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

• L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance

Visofold 5000

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
0.3						0.3	0.3	0.3	0.3
0.4	0.3	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4
0.5	0.3	0.5	0.5	0.5	0.6	0.6	0.6	0.6	0.6
0.6	0.5	0.6	0.7	0.7	0.7	0.7	0.7	0.7	0.7
0.7	0.6	0.7	0.8	0.8	0.8	0.8	0.8	0.8	0.8
0.8	0.7	0.8	0.9	0.9	0.9	1.0	1.0	1.0	1.0
0.9	0.8	0.9	1.0	1.0	1.0	1.1	1.1	1.1	1.1
1.0	0.9	1.0	1.1	1.1	1.1	1.2	1.2	1.2	1.2
1.1	1.0	1.1	1.2	1.2	1.2	1.3	1.3	1.3	1.3
1.2	1.1	1.2	1.3	1.3	1.3	1.4	1.4	1.4	1.4
1.3	1.2	1.3	1.4	1.4	1.4	1.5	1.5	1.5	1.5
1.4	1.3	1.4	1.5	1.5	1.5	1.6	1.6	1.6	1.6
1.5	1.4	1.5	1.6	1.6	1.6	1.7	1.7	1.7	1.7
1.6	1.5	1.6	1.7	1.7	1.7	1.8	1.8	1.8	1.8
1.7	1.6	1.7	1.8	1.8	1.8	1.9	1.9	1.9	1.9
1.8	1.7	1.8	1.9	1.9	1.9	2.0	2.0	2.0	2.0
1.9	1.8	1.9	2.0	2.0	2.0	2.1	2.1	2.1	2.1
2.0	1.9	2.0	2.1	2.1	2.1	2.2	2.2	2.2	2.2
2.1	2.0	2.1	2.2	2.2	2.2	2.3	2.3	2.3	2.3
2.2	2.1	2.2	2.3	2.3	2.3	2.4	2.4	2.4	2.4

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	○	●	○
●	○	●	○
○	○	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 10077-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

•L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance

Visofold 6000

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
					0.3	0.3	0.3	0.3	0.3
	0.4	0.4	0.4	0.4	0.4	0.5	0.5	0.5	0.5
0.4	0.5	0.5	0.5	0.5	0.6	0.6	0.6	0.6	0.6
0.5	0.6	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
0.6	0.7	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
0.7	0.9	0.9	0.9	0.9	1.0	1.0	1.0	1.0	1.0
0.9	1.0	1.0	1.0	1.1	1.1	1.1	1.1	1.1	1.1
1.0	1.1	1.2	1.2	1.2	1.2	1.2	1.2	1.2	1.2
1.1	1.2	1.3	1.3	1.3	1.3	1.3	1.3	1.3	1.3
1.2	1.4	1.4	1.4	1.4	1.5	1.5	1.5	1.5	1.5
1.4	1.5	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6
1.5	1.6	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7
1.6	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.9
1.8	1.9	1.9	1.9	1.9	2.0	2.0	2.0	2.0	2.0
1.9	2.0	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1
2.0	2.1	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2
2.1	2.3	2.3	2.3	2.3	2.3	2.4	2.4	2.4	2.4

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	○	●	○
●	○	●	○
○	○	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 10077-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

• L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance

Visoglide

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
					0.3	0.3	0.3	0.3	0.3
	0.4	0.4	0.4	0.4	0.5	0.5	0.5	0.5	0.5
0.4	0.5	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6
0.5	0.6	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
0.6	0.8	0.8	0.8	0.8	0.9	0.9	0.9	0.9	0.9
0.8	0.9	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
0.9	1.0	1.1	1.1	1.1	1.1	1.1	1.1	1.1	1.2
1.1	1.2	1.2	1.2	1.3	1.3	1.3	1.3	1.3	1.3
1.2	1.3	1.4	1.4	1.4	1.4	1.4	1.4	1.4	1.4
1.3	1.5	1.5	1.5	1.5	1.6	1.6	1.6	1.6	1.6
1.5	1.6	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7
1.6	1.7	1.8	1.8	1.8	1.8	1.8	1.8	1.8	1.8
1.7	1.9	1.9	1.9	1.9	2.0	2.0	2.0	2.0	2.0
1.9	2.0	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	○	●	○
●	○	●	○
○	○	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 1007-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

• L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance

Visoglide Plus

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
0.4	0.5	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6
0.5	0.7	0.7	0.7	0.7	0.8	0.8	0.8	0.8	0.8
0.7	0.8	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9
0.8	0.9	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
1.0	1.1	1.1	1.1	1.1	1.2	1.2	1.2	1.2	1.2
1.1	1.2	1.3	1.3	1.3	1.3	1.3	1.3	1.3	1.3
1.2	1.4	1.4	1.4	1.4	1.4	1.5	1.5	1.5	1.5
1.4	1.5	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6
1.5	1.6	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7
1.6	1.8	1.8	1.8	1.8	1.9	1.9	1.9	1.9	1.9
1.8	1.9	2.0	2.0	2.0	2.0	2.0	2.0	2.0	2.0
1.9	2.0	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1
2.1	2.2	2.2	2.2	2.2	2.3	2.3	2.3	2.3	2.3
2.2	2.3	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	○	●	○
●	○	●	○
○	○	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 10077-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

• L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance VS 600

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K
1.0
1.1
1.2
1.3
1.4
1.5
1.6
1.7
1.8
1.9
2.0
2.1
2.2
2.3
2.4
2.5
2.6

Glazing Specification									
Typical Spacer Bar Performances ²									
W/m									
Aluminium Typical 0.111	Stainl Steel Typical 0.069	TGI Spacer M TechnoForm 0.049	Thermix TX Pro Ensinger 0.049	Chromatech Ultra F Rolltech 0.048	Super Spacer TruPlus Edgetech 0.038	Thermobar Thermoseal 0.036	Super Spacer TriSeal Edgetech 0.036	Swisspacer Ultimate Saint-Gobain 0.036	SuperSpacer Premium Edgetech 0.035
Centre Pane ¹									
W/m²K									
		0.3	0.3	0.3	0.4	0.4	0.4	0.4	0.4
	0.4	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
0.4	0.5	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.7
0.5	0.7	0.7	0.7	0.7	0.8	0.8	0.8	0.8	0.8
0.7	0.8	0.9	0.9	0.9	0.9	0.9	0.9	0.9	0.9
0.8	0.9	1.0	1.0	1.0	1.0	1.1	1.1	1.1	1.1
0.9	1.1	1.1	1.1	1.1	1.2	1.2	1.2	1.2	1.2
1.1	1.2	1.3	1.3	1.3	1.3	1.3	1.3	1.3	1.3
1.2	1.3	1.4	1.4	1.4	1.4	1.5	1.5	1.5	1.5
1.3	1.5	1.5	1.5	1.5	1.6	1.6	1.6	1.6	1.6
1.5	1.6	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7
1.6	1.7	1.8	1.8	1.8	1.8	1.9	1.9	1.9	1.9
1.7	1.9	1.9	1.9	1.9	2.0	2.0	2.0	2.0	2.0
1.9	2.0	2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.1
2.0	2.1	2.2	2.2	2.2	2.2	2.3	2.3	2.3	2.3
2.1	2.3	2.3	2.3	2.3	2.4	2.4	2.4	2.4	2.4

ADL			
Domestic		Commercial	
L1A New Domestic	L1B Referb Domestic	L2A New Commercial	L2B Referb Commercial
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	●	●	●
●	①	●	●
●	①	●	●
●	①	●	○
●	①	●	○
○	①	●	○
○	○	●	○
○	○	○	○
○	○	○	○
○	○	○	○

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 10077-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

•①L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance

Designer Door

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



U Value W/m²K	Door Reference	
1.4	DM0001	Amersham
1.4	DM0002	Ashwell
1.3	DM0003	Bloomsbury
1.4	DM0004	Broadstone
1.3	DM0005	Canonbury
1.4	DM0006	Clifton
1.3	DM0007	Eastleigh
1.4	DM0008	Falmouth
1.3	DM0009	Hambleton
1.4	DM0010	Highgate
1.4	DM0011	Kingsbridge
1.4	DM0012	Kensington
1.4	DM0013	Lymington
1.4	DM0014	Marlborough
1.4	DM0015	Oakham
1.5	DM0016	Pembroke
1.4	DM0017	Mayfair
1.5	DM0018	Purbeck
1.5	DM0019	Rushcliffe
1.4	DM0020	Pimlico
1.3	DM0021	Sherbourne
1.5	DM0022	Richmond
1.5	DM0023	Shipston
1.3	DM0024	Teddington
1.4	DM0025	Twickenham
1.3	DM0026	Winchester
1.3	DM0027	Woodbridge
1.4	DM0028	Westbury
1.5	DM0029	Amersham 2
1.5	DM0030	Oakham 2
1.3	DM0031	Oxford
1.5	DM0032	Amersham 3
1.3	DM0033	Highgate
1.3	DM0034	Ledbury
1.3	DM0037	Malton
1.3	DM0041	Oxford 2
1.3	DM9000	Amesbury

U Value W/m²K	Door Reference	
1.7	DT0001	Greenway
1.7	DT0002	Elberry
1.9	DT0003	Edwardian
1.8	DT0004	Georgian
1.8	DT0005	Regency
1.8	DT0006	Victorian
1.6	DT0007	Windsor
1.4	DT0008	Coleford
1.3	DT0009	Axbridge
1.4	DT0010	Churchill
1.4	DT0011	Purton
1.3	DT0012	Somerton
2.1	DT0013	Edwardian 2
1.3	DT0014	Ashcott
2.0	DT0015	Regency 2
2.1	DT0016	Victorian 2
2.1	DT0023	Elberry 2
1.3	DT0024	Elberry 3
1.4	DT0025	Edwardian 3
1.3	DT0026	Edwardian 4
2.1	DT0027	Georgian 2
1.4	DT0028	Georgian 3
1.3	DT0029	Georgian 4
1.5	DT0030	Regency 3
1.3	DT0031	Regency 4
1.3	DT0032	Victorian 3

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 1007-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

*U_{L1B} dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance Orangery

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1



Centre Pane	W L	U Value								
		1000	1000	1000	1000	1000	2000	2000	2000	
		2000	2500	3000	3500	4000	3000	3500	4000	
0.5		1.2	1.2	1.2	1.2	1.1	1.0	1.0	0.9	
0.6		1.3	1.3	1.2	1.2	1.2	1.1	1.0	1.0	
0.7		1.4	1.3	1.3	1.3	1.3	1.2	1.1	1.1	
0.8		1.4	1.4	1.4	1.4	1.4	1.2	1.2	1.2	
0.9		1.5	1.5	1.4	1.4	1.4	1.3	1.3	1.3	
1.0		1.6	1.5	1.5	1.5	1.5	1.4	1.4	1.3	
1.1		1.6	1.6	1.6	1.6	1.6	1.5	1.4	1.4	
1.2		1.7	1.7	1.6	1.6	1.6	1.5	1.5	1.5	
1.3		1.8	1.7	1.7	1.7	1.7	1.6	1.6	1.6	
1.4		1.8	1.8	1.8	1.8	1.8	1.7	1.7	1.7	
1.5		1.9	1.9	1.9	1.8	1.8	1.8	1.7	1.7	
1.6		1.9	1.9	1.9	1.9	1.9	1.8	1.8	1.8	
1.7		2.0	2.0	2.0	2.0	2.0	1.9	1.9	1.9	
1.8		2.1	2.1	2.1	2.0	2.0	2.0	2.0	2.0	
1.9		2.1	2.1	2.1	2.1	2.1	2.1	2.1	2.0	
2.0		2.2	2.2	2.2	2.2	2.2	2.1	2.1	2.1	

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows


³ Calculated overall thermal performance to BS EN ISO 1007-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

•⓪L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

Thermal Performance Rooflight

Thermal Simulation BS EN ISO 10077-2
BS EN 14351-1

Centre Pane	W L	U Value			
		1000	1000	1000	1500
		1000	1500	2000	1500
0.5		1.0	0.8	0.9	0.8
0.6		1.1	0.9	0.9	0.9
0.7		1.2	1.0	1.0	0.9
0.8		1.2	1.1	1.1	1.0
0.9		1.3	1.2	1.2	1.1
1.0		1.4	1.2	1.3	1.2
1.1		1.4	1.3	1.3	1.3
1.2		1.5	1.4	1.4	1.4
1.3		1.6	1.5	1.5	1.5
1.4		1.6	1.6	1.6	1.6
1.5		1.7	1.7	1.7	1.6
1.6		1.8	1.7	1.8	1.7
1.7		1.8	1.8	1.8	1.8
1.8		1.9	1.9	1.9	1.9
1.9		2.0	2.0	2.0	2.0
2.0		2.0	2.1	2.1	2.1

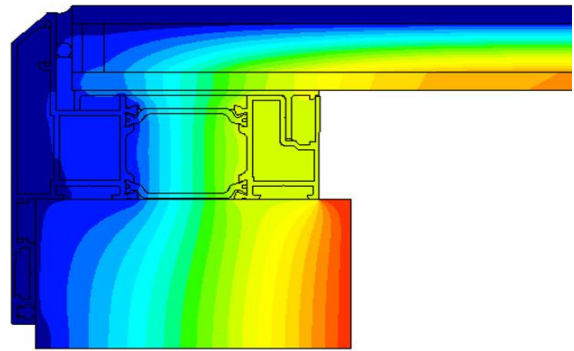

System Thermal Performance.

Calculation in accordance with BR443, Thermal transmittance of system from numerical method of simulations, BS EN ISO 10077-2

¹ Thermal Transmittance of glazing (Centre Pane) to be determined in accordance with EN 673, EN 674 or EN675.

² Spacer Bar Data to be Calculated in accordance with ift-Guidelines WA-08 'Determination of representative values for profile sections of windows

³ Calculated overall thermal performance to BS EN ISO 1007-1 configuration to EN 14351-1 Annex E as per UK 2010 Building Regulations.

•⓪L1B dependent on g value of glazing windows may also be compliant with energy rating calculation

References

[1] The Building Regulations: Approved Documents L1A, L1B, L2A and L2B, 2006 Edition, obtainable from www.planningportal.gov.uk

[2] SAP 2009: *The BRE's Standard Assessment Procedure for Energy Rating of Dwellings*, obtainable from www.bre.co.uk/sap2009/

[3] Conventions for U Value Calculations, BRE443 obtainable from www.bre.co.uk

Calculation Methods

BS EN ISO 6946* Thermal performance of buildings and building components – Thermal resistance and thermal transmittance – Calculation method

BS EN ISO 10077-1* Thermal performance of windows, doors and shutters – Calculation of thermal transmittance – Part 1: Simplified methods

BS EN ISO 10077-2 Thermal performance of windows, doors and shutters – Calculation of thermal transmittance – Part 2: Numerical methods for frames

EN 13947 Thermal performance of curtain walling – Calculation of thermal transmittance

Measurement methods

BS EN ISO 12567-1 Thermal performance of windows and doors – Determination of thermal transmittance by hot box method – Part 1: Complete windows and doors

BS EN ISO 12567-2 Thermal performance of windows and doors – Determination of thermal transmittance by hot box method – Part 2: Roof windows and other projecting Windows

White Paper
Building Regulations Approved Document L

smart
architectural aluminium

Copyright © Smart Systems